

CERTIFICATE OF ANALYSIS

REPORTED TO Osoyoos, Town of
PO Box 3010
OSOYOOS, BC V0H 1V0

ATTENTION Jared Brounstein

PO NUMBER

PROJECT General Potability

PROJECT INFO

WORK ORDER 22D3136

RECEIVED / TEMP 2022-04-26 14:30 / 11.4°C

REPORTED 2022-05-02 13:05

COC NUMBER No Number

Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO/IEC 17025:2017 for specific tests listed in the scope of accreditation approved by CALA.

Big Picture Sidekicks



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

We've Got Chemistry



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

Ahead of the Curve




Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.

If you have any questions or concerns, please contact me at bwhitehead@caro.ca

Authorized By:

Brent Whitehead
Account Manager



1-888-311-8846 | www.caro.ca

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7 | #108 4475 Wayburne Drive Burnaby, BC V5G 4X4

TEST RESULTS

REPORTED TO PROJECT Osoyoos, Town of
General Potability

WORK ORDER REPORTED 22D3136
2022-05-02 13:05

Analyte	Result	Guideline	RL	Units	Analyzed	Qualifier
---------	--------	-----------	----	-------	----------	-----------

System #8, Station #8 Intake (22D3136-01) | Matrix: Water | Sampled: 2022-04-26 09:15

Anions

Chloride	9.16	AO ≤ 250	0.10	mg/L	2022-04-27	
Fluoride	0.30	MAC = 1.5	0.10	mg/L	2022-04-27	
Nitrate (as N)	< 0.010	MAC = 10	0.010	mg/L	2022-04-27	
Nitrite (as N)	< 0.010	MAC = 1	0.010	mg/L	2022-04-27	
Sulfate	30.7	AO ≤ 500	1.0	mg/L	2022-04-27	

Calculated Parameters

Hardness, Total (as CaCO ₃)	126	None Required	0.500	mg/L	N/A	
Solids, Total Dissolved	180	AO ≤ 500	1.00	mg/L	N/A	

General Parameters

Alkalinity, Total (as CaCO ₃)	133	N/A	1.0	mg/L	2022-04-30	
Alkalinity, Phenolphthalein (as CaCO ₃)	< 1.0	N/A	1.0	mg/L	2022-04-30	
Alkalinity, Bicarbonate (as CaCO ₃)	133	N/A	1.0	mg/L	2022-04-30	
Alkalinity, Carbonate (as CaCO ₃)	< 1.0	N/A	1.0	mg/L	2022-04-30	
Alkalinity, Hydroxide (as CaCO ₃)	< 1.0	N/A	1.0	mg/L	2022-04-30	
Conductivity (EC)	311	N/A	2.0	µS/cm	2022-04-30	
Cyanide, Total	< 0.0020	MAC = 0.2	0.0020	mg/L	2022-04-30	
pH	8.01	7.0-10.5	0.10	pH units	2022-04-30	HT2
Turbidity	0.97	OG < 1	0.10	NTU	2022-04-26	

Total Metals

Aluminum, total	0.0128	OG < 0.1	0.0050	mg/L	2022-04-30	
Antimony, total	< 0.00020	MAC = 0.006	0.00020	mg/L	2022-04-30	
Arsenic, total	0.00061	MAC = 0.01	0.00050	mg/L	2022-04-30	
Barium, total	0.0271	MAC = 2	0.0050	mg/L	2022-04-30	
Boron, total	< 0.0500	MAC = 5	0.0500	mg/L	2022-04-30	
Cadmium, total	< 0.000010	MAC = 0.005	0.000010	mg/L	2022-04-30	
Calcium, total	33.3	None Required	0.20	mg/L	2022-04-30	
Chromium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2022-04-30	
Copper, total	0.0111	MAC = 2	0.00040	mg/L	2022-04-30	
Iron, total	0.023	AO ≤ 0.3	0.010	mg/L	2022-04-30	
Lead, total	< 0.00020	MAC = 0.005	0.00020	mg/L	2022-04-30	
Magnesium, total	10.4	None Required	0.010	mg/L	2022-04-30	
Manganese, total	0.00994	MAC = 0.12	0.00020	mg/L	2022-04-30	
Potassium, total	2.62	N/A	0.10	mg/L	2022-04-30	
Selenium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2022-04-30	
Sodium, total	12.5	AO ≤ 200	0.10	mg/L	2022-04-30	
Strontium, total	0.329	MAC = 7	0.0010	mg/L	2022-04-30	
Uranium, total	0.00278	MAC = 0.02	0.000020	mg/L	2022-04-30	
Zinc, total	0.0082	AO ≤ 5	0.0040	mg/L	2022-04-30	


System #9, Station #9 Intake (22D3136-02) | Matrix: Water | Sampled: 2022-04-26 11:40

TEST RESULTS

REPORTED TO PROJECT Osoyoos, Town of
General Potability

WORK ORDER REPORTED 22D3136
2022-05-02 13:05

Analyte	Result	Guideline	RL Units	Analyzed	Qualifier
System #9, Station #9 Intake (22D3136-02) Matrix: Water Sampled: 2022-04-26 11:40, Continued					
Anions					
Chloride	8.86	AO ≤ 250	0.10 mg/L	2022-04-27	
Fluoride	0.26	MAC = 1.5	0.10 mg/L	2022-04-27	
Nitrate (as N)	< 0.010	MAC = 10	0.010 mg/L	2022-04-27	
Nitrite (as N)	< 0.010	MAC = 1	0.010 mg/L	2022-04-27	
Sulfate	30.5	AO ≤ 500	1.0 mg/L	2022-04-27	
Calculated Parameters					
Hardness, Total (as CaCO ₃)	123	None Required	0.500 mg/L	N/A	
Solids, Total Dissolved	176	AO ≤ 500	1.00 mg/L	N/A	
General Parameters					
Alkalinity, Total (as CaCO ₃)	130	N/A	1.0 mg/L	2022-04-30	
Alkalinity, Phenolphthalein (as CaCO ₃)	< 1.0	N/A	1.0 mg/L	2022-04-30	
Alkalinity, Bicarbonate (as CaCO ₃)	130	N/A	1.0 mg/L	2022-04-30	
Alkalinity, Carbonate (as CaCO ₃)	< 1.0	N/A	1.0 mg/L	2022-04-30	
Alkalinity, Hydroxide (as CaCO ₃)	< 1.0	N/A	1.0 mg/L	2022-04-30	
Conductivity (EC)	309	N/A	2.0 µS/cm	2022-04-30	
Cyanide, Total	< 0.0020	MAC = 0.2	0.0020 mg/L	2022-04-30	
pH	7.89	7.0-10.5	0.10 pH units	2022-04-30	HT2
Turbidity	1.19	OG < 1	0.10 NTU	2022-04-26	
Total Metals					
Aluminum, total	0.0166	OG < 0.1	0.0050 mg/L	2022-04-30	
Antimony, total	< 0.00020	MAC = 0.006	0.00020 mg/L	2022-04-30	
Arsenic, total	0.00064	MAC = 0.01	0.00050 mg/L	2022-04-30	
Barium, total	0.0263	MAC = 2	0.0050 mg/L	2022-04-30	
Boron, total	< 0.0500	MAC = 5	0.0500 mg/L	2022-04-30	
Cadmium, total	< 0.000010	MAC = 0.005	0.000010 mg/L	2022-04-30	
Calcium, total	32.2	None Required	0.20 mg/L	2022-04-30	
Chromium, total	< 0.00050	MAC = 0.05	0.00050 mg/L	2022-04-30	
Copper, total	0.00518	MAC = 2	0.00040 mg/L	2022-04-30	
Iron, total	0.026	AO ≤ 0.3	0.010 mg/L	2022-04-30	
Lead, total	< 0.00020	MAC = 0.005	0.00020 mg/L	2022-04-30	
Magnesium, total	10.2	None Required	0.010 mg/L	2022-04-30	
Manganese, total	0.00956	MAC = 0.12	0.00020 mg/L	2022-04-30	
Potassium, total	2.56	N/A	0.10 mg/L	2022-04-30	
Selenium, total	< 0.00050	MAC = 0.05	0.00050 mg/L	2022-04-30	
Sodium, total	12.3	AO ≤ 200	0.10 mg/L	2022-04-30	
Strontium, total	0.317	MAC = 7	0.0010 mg/L	2022-04-30	
Uranium, total	0.00270	MAC = 0.02	0.000020 mg/L	2022-04-30	
Zinc, total	< 0.0040	AO ≤ 5	0.0040 mg/L	2022-04-30	

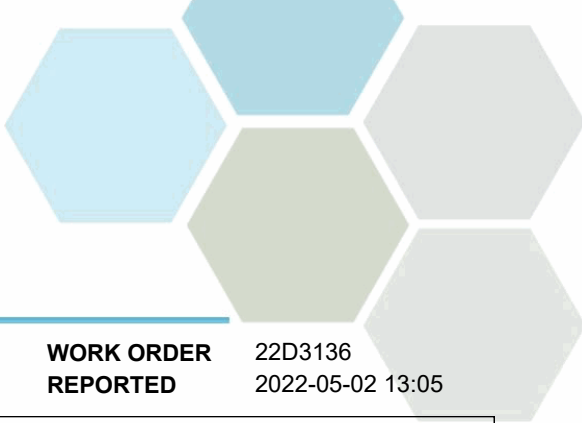

TEST RESULTS

REPORTED TO	Osoyoos, Town of	WORK ORDER	22D3136
PROJECT	General Potability	REPORTED	2022-05-02 13:05

Sample Qualifiers:
HT2 The 15 minute recommended holding time (from sampling to analysis) has been exceeded - field analysis is recommended.

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT Osoyoos, Town of
General Potability

WORK ORDER REPORTED 22D3136
2022-05-02 13:05

Analysis Description	Method Ref.	Technique	Accredited	Location
Alkalinity in Water	SM 2320 B* (2017)	Titration with H ₂ SO ₄	✓	Kelowna
Anions in Water	SM 4110 B (2017)	Ion Chromatography	✓	Kelowna
Conductivity in Water	SM 2510 B (2017)	Conductivity Meter	✓	Kelowna
Cyanide, SAD in Water	ASTM D7511-12	Flow Injection with In-Line UV Digestion and Amperometry	✓	Kelowna
Hardness in Water	SM 2340 B* (2017)	Calculation: 2.497 [total Ca] + 4.118 [total Mg] (Est)	✓	N/A
pH in Water	SM 4500-H+ B (2017)	Electrometry	✓	Kelowna
Solids, Total Dissolved in Water	SM 1030 E (2017)	SM 1030 E (2011)		N/A
Total Metals in Water	EPA 200.2 / EPA 6020B	HNO ₃ +HCl Hot Block Digestion / Inductively Coupled Plasma-Mass Spectroscopy (ICP-MS)	✓	Richmond
Turbidity in Water	SM 2130 B (2017)	Nephelometry	✓	Kelowna

Note: An asterisk in the Method Reference indicates that the CARO method has been modified from the reference method

Glossary of Terms:

RL	Reporting Limit (default)
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
AO	Aesthetic Objective
MAC	Maximum Acceptable Concentration (health based)
mg/L	Milligrams per litre
NTU	Nephelometric Turbidity Units
OG	Operational Guideline (treated water)
pH units	pH < 7 = acidic, pH > 7 = basic
µS/cm	Microsiemens per centimetre
ASTM	ASTM International Test Methods
EPA	United States Environmental Protection Agency Test Methods
SM	Standard Methods for the Examination of Water and Wastewater, American Public Health Association

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT Osoyoos, Town of
General Potability

WORK ORDER REPORTED 22D3136
2022-05-02 13:05

General Comments:

The results in this report apply to the samples analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety. CARO is not responsible for any loss or damage resulting directly or indirectly from error or omission in the conduct of testing. Liability is limited to the cost of analysis. Samples will be disposed of 30 days after the test report has been issued or once samples expire, whichever comes first. Longer hold is possible if agreed to in writing. The quality control (QC) data is available upon request

Results in **Bold** indicate values that are above CARO's method reporting limits. Any results that are above regulatory limits are highlighted **red**. Please note that results will only be highlighted red if the regulatory limits are included on the CARO report. Any Bold and/or highlighted results do not take into account method uncertainty. If you would like method uncertainty or regulatory limits to be included on your report, please contact your Account Manager: bwhitehead@caro.ca

Please note any regulatory guidelines applied to this report are added as a convenience to the client, at their request, to help provide some initial context to analytical results obtained. Although CARO makes every effort to ensure accuracy of the associated regulatory guideline(s) applied, the guidelines applied cannot be assumed to be correct due to a variety of factors and as such CARO Analytical Services assumes no liability or responsibility for the use of those guidelines to make any decisions. The original source of the regulation should be verified and a review of the guideline(s) should be validated as correct in order to make any decisions arising from the comparison of the analytical data obtained to the relevant regulatory guideline for one's particular circumstances. Further, CARO Analytical Services assumes no liability or responsibility for any loss attributed from the use of these guidelines in any way.